



**Baltimore Aircoil**



**RCF**

*CLOSED CIRCUIT COOLING TOWERS*



**COUNTERFLOW INDUCED DRAFT**

*...because temperature matters®*




## GENERAL DESCRIPTION:

Commercial applications demand reliable, cost effective and energy efficient solutions. With an ever increasing focus on operational reliability and ease of maintenance. It is paramount that cooling equipment be also easy to inspect, clean & maintain. The RCF evaporative fluid cooler responds to all these requirements thanks to built-in design features.

Industrial applications face unique challenges in their processes with varying site conditions. The RCF evaporative fluid cooler provides solutions to these challenges by reducing the cost of plant design, construction, operation and on-going maintenance, whilst improving the standard of quality and construction, required by medium to heavy industry.

## CONSTRUCTION DETAILS:

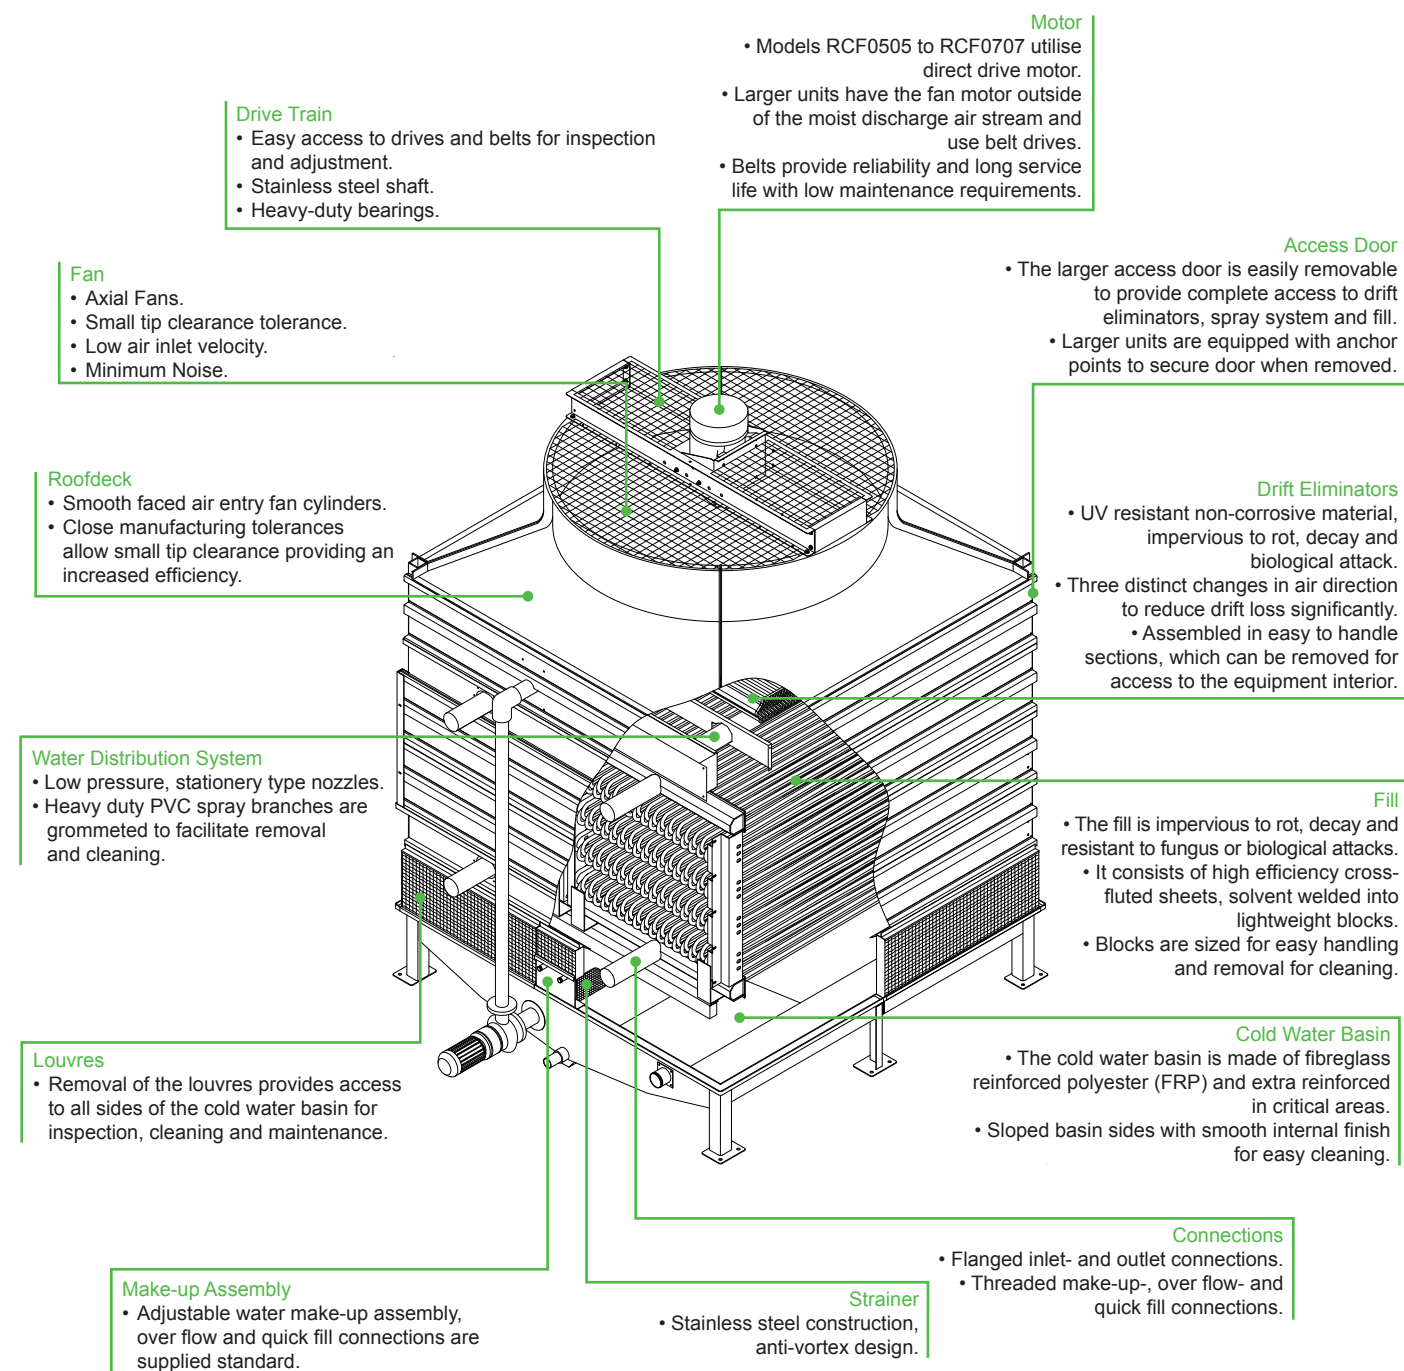

## KEY BENEFITS:

### Compliance

- **Free Draining Cold Water Basin** - The sloping fluid cooler basin allows for free draining to comply with AS3666.
- **Smooth Internal Surfaces** - The internal surfaces of the fluid cooler are smooth to facilitate cleaning.
- **Coil headers** designed to AS2971 in conjunction with a certified ISO 9001 Quality Assurance Program. Each coil is pressure tested to 2750 kPa after fabrication and prior to final assembly.

### Low Energy Consumption

- Evaporative cooling equipment minimises the energy consumption of the entire system because it provides lower operating temperatures. The owner saves money while conserving natural resources and reducing environmental impact.
- The fluid coolers provide the heat rejection required at the lowest possible energy input via:
  - High efficiency, low kW axial fans.
  - Variable Frequency Drives.

### Low Installed Cost

Single or multiplexed configurations, common or segmented basins, partitioned or extended air inlets and increased capacity control steps, all are but a few examples of the flexible modular evaporative fluid cooler design.

The fluid cooler can be shipped directly from the factory as a fully assembled unit, as unit modules or knocked down, to suit diverse and often restricted on-site conditions.

The low shipping weights and modular shipping options reduce transport and crane costs. Lifting lugs, provided as standard, offer secure fixing points for safe crane lifts. Lower installation costs are achieved due to solvent welded drain connections and threaded make-up, overflow and quick-fill connections.







## KEY BENEFITS:

### Easy Maintenance

- **Access to complete unit interior**  
The large access panels are fitted with easily removable knobs. Removing the access panels does not require any tools or dismantling of the fluid cooler structure, providing unequalled access to all of the internal fluid cooler components for inspection, cleaning and maintenance.
- **Basin Accessible from all Sides**  
Removal of the louvres, requiring no tools, provides access to all sides of the smooth faced cold water basin for inspection, cleaning and maintenance.
- **Easy Access to Float Valve**  
Access to and adjustment of the float valve is simplified. The stainless steel pump suction strainer can easily be inspected, removed and cleaned inside.
- **Removable Spray System**  
Cleaning and inspection of the spray system can be performed insitu or by removing the spray branch arms. No tools are required for the removal of the branch arms or the individual water distribution nozzles.
- **Removable Eliminators**  
Removal of high efficiency drift eliminators can be accomplished easily without the removal of other internal components or by having to dismantle the fluid cooler structure. The eliminators rest on supports specifically designed for this purpose.
- **Motor Outside Airstream**  
Units RCF0808 and larger include an adjustable motor base plate for belt tensioning, extended lubrication lines with externally mounted grease nipples are provided as standard for ease of scheduled maintenance. Smaller units are supplied as direct drive units.
- **Easy Access to Drives**  
Removal of the fan screen for access to belts and drives is not required. These drive components are easily accessible through the specially designed hinged belt guard for inspection adjustment or replacement purposes.

### Long Service Life

- **Superior Pultruded Composite Construction** - The use of high strength Pultruded Composite components for the primary structure combined with BAC's patented "Bonded Panel to Post Connection", offers many advantages over conventional hand laid or chopped strand fibreglass construction methods. Pultruded composites possess a superior strength to weight ratio of up to five times that of chopped strand fibreglass.

## FEATURES & ACCESSORIES:

### Construction Options

**Standard construction:** High strength pultruded composite components for the primary structure combined with patented bonded panel to post connection.

### Fan Drive System

High efficiency fans with direct drive motors for models RCF0505 to RCF0707. Larger models are belt driven. All belt driven units have extended lubrication lines to the edge of the fan cylinder. The mechanical equipment support is made of ZAM coated steel. Fan guards are made of hot dip galvanised steel.

**Optional:** Mechanical equipment support assembly and fan guards in SST 304 or SST 316.

### Cold Water Basin

The RCF Fluid Cooler cold water basin is constructed of high performance fibreglass reinforced polyester and includes make-up, quick-fill, overflow, and drain connection.

**Optional:** Units can be supplied without cold water basin for field assembly on a concrete tank.

### Factory Assembled

The RCF Fluid Cooler is completely factory-assembled.


**Optional:** The Fluid Cooler can be shipped in knocked-down version for assembly on site. This enables overseas transport in containers and significantly reduces transport cost.

### Heat Transfer Surface Alternatives

Prime surface heat transfer coils are available in either hot-dip galvanised steel or stainless steel. Both options are designed in accordance with AS2971 and manufactured within an ISO:9001 certified Quality Assurance Program. Each coil is pressure tested to 2750 kPa after fabrication and prior to final assembly of the RCF evaporative fluid cooler.





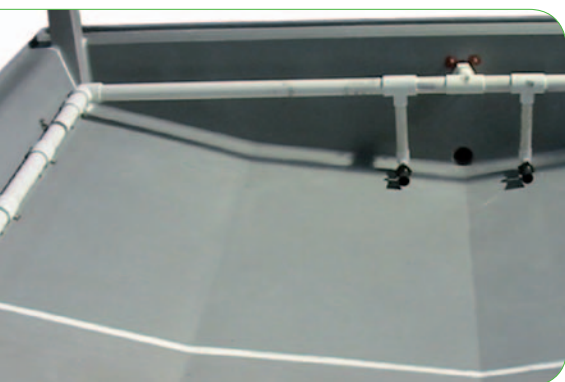

### FEATURES & ACCESSORIES:

#### Basin Sweeper Piping

Basin sweeper piping provides an effective method of preventing sediment from collecting in the cold water basin of the unit. A complete piping system, including nozzles, is provided in the unit basin for connection to side stream filtration equipment.

#### Ladder and Platform

For the purposes of access to the drive system for inspection or maintenance, ladders and platforms can be provided. These can either take the form of factory assembled pods for inspection, or customised ladders and platforms designed to meet site specific conditions. All ladders and platforms are designed in accordance with AS1657. Ladders can be supplied at any length within the constraints of the standard.

#### Controls

BAC provide optional preprogrammed VFD's using the design conditions provided with the evaporative cooling equipment and the fan motor data at time of manufacture. These factory settings provide the evaporative equipment operator or commissioning personnel the flexibility to start the equipment using the factory preprogrammed settings or customise any of the control parameters to suit the application or site specific conditions. The VFD is programmed in PID Control with Auto Start, Sleep Mode and a Set Point Reference. A Temperature Sensor is factory installed at the fluid cooler coil outlet which measures the leaving fluid temperature.

#### Vibration Cut-out Switch


A factory-mounted vibration cut-out switch is available to effectively protect against equipment failure due to excessive vibration of the mechanical equipment system. BAC can provide a vibration cut-out switch in an IP65 enclosure to ensure reliable protection.





ENGINEERING DATA - 304SST COIL UNIT DIMENSIONS:

Single Fan Units - Square Box Sizes

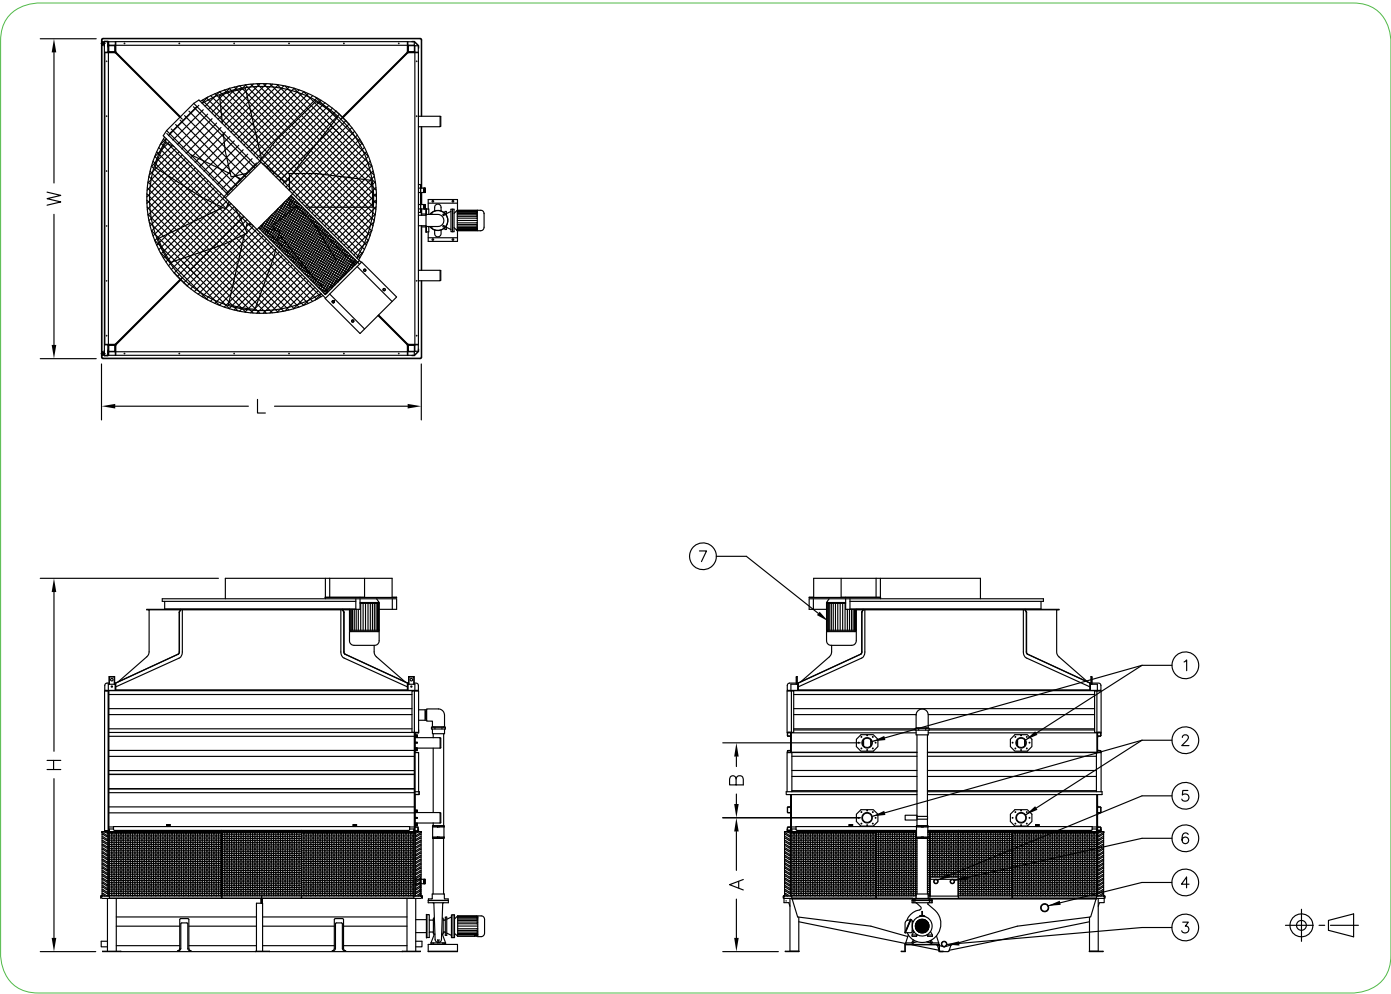

1. Fluid Inlet 100NB (Box Size 5x5, 6x6, 7x7 and 7x10.5 Have Single Coil Connection); 2. Fluid Outlet 100NB (Box Size 5x5, 6x6, 7x7 and 7x10.5 Have Single Coil Connection); 3. Drain; 4. Overflow; 5. Make-Up; 6. Quick Fill; 7. Fan Motor.


ENGINEERING DATA - 304SST COIL UNIT DIMENSIONS:

Model No. RCF (SST Coil)	W (mm)	L (mm)	H (mm)	A	B	Shipping Weight (kg)	Operating Weight (kg)	Heaviest Section (kg)	Fan Motor (kW)	Air Flow (m³/s)	Water Flow (l/s)	Pump Motor (kW)	Drain NB (mm)	Overflow NB (mm)	Make -Up NB (mm)	Quick -fill NB (mm)
RCF0505-2-I	1675	1675	3315	910	1120	1380	2300	1050	4	7.61	6.8	0.55	50	50	15	15
RCF0505-3-I	1675	1675	3510	910	1315	1560	2550	1230	4	7.28	6.8	0.55	50	50	15	15
RCF0505-3-J	1675	1675	3510	910	1315	1560	2550	1230	5.5	8.31	6.8	0.55	50	50	15	15
RCF0606-2-G	1980	1980	3585	970	1120	1830	3150	1549	2.2	8.15	9.8	1.1	50	50	15	15
RCF0606-2-I	1980	1980	3585	970	1120	1830	3150	1549	4	9.69	9.8	1.1	50	50	15	15
RCF0606-2-J	1980	1980	3585	970	1120	1830	3150	1549	5.5	11.06	9.8	1.1	50	50	15	15
RCF0606-3-I	1980	1980	3780	970	1315	2080	3500	1800	4	9.28	9.8	1.1	50	50	15	15
RCF0606-3-J	1980	1980	3780	970	1315	2080	3500	1800	5.5	10.59	9.8	1.1	50	50	15	15
RCF0606-3-K	1980	1980	3780	970	1315	2080	3500	1800	7.5	11.75	9.8	1.1	50	50	15	15
RCF0707-2-I	2285	2285	3775	1025	1120	2390	4100	2050	4	11.91	13.3	1.1	50	50	20	20
RCF0707-2-J	2285	2285	3775	1025	1120	2390	4100	2050	5.5	13.59	13.3	1.1	50	50	20	20
RCF0707-2-K	2285	2285	3775	1025	1120	2390	4100	2050	7.5	15.07	13.3	1.1	50	50	20	20
RCF0707-3-J	2285	2285	3970	1025	1315	2730	4600	2390	5.5	13.01	13.3	1.1	50	50	20	20
RCF0707-3-K	2285	2285	3970	1025	1315	2730	4600	2390	7.5	14.43	13.3	1.1	50	50	20	20
RCF0707-3-L	2285	2285	3970	1025	1315	2730	4600	2390	11	16.40	13.3	1.1	50	50	20	20
RCF0808-2-K	2590	2590	3755	1075	1120	3050	5250	2790	7.5	18.01	17.4	1.5	50	80	20	20
RCF0808-2-L	2590	2590	3755	1075	1120	3050	5250	2790	11	20.46	17.4	1.5	50	80	20	20
RCF0808-3-K	2590	2590	3950	1075	1315	3500	5850	3230	7.5	17.24	17.4	1.5	50	80	20	20
RCF0808-3-L	2590	2590	3950	1075	1315	3500	5850	3230	11	19.59	17.4	1.5	50	80	20	20
RCF0909-2-K	2895	2895	3885	1135	1120	3810	6450	3500	7.5	21.07	22.0	1.5	50	80	20	20
RCF0909-2-L	2895	2895	3885	1135	1120	3810	6450	3500	11	23.94	22.0	1.5	50	80	20	20
RCF0909-3-L	2895	2895	4080	1135	1315	4380	7200	4060	11	22.92	22.0	1.5	50	80	20	20
RCF0909-3-M	2895	2895	4080	1135	1315	4380	7200	4060	15	25.41	22.0	1.5	50	80	20	20
RCF1010-2-L	3200	3200	4125	1190	1120	4580	7750	4210	11	27.55	27.1	2.2	50	80	40	40
RCF1010-2-M	3200	3200	4125	1190	1120	4580	7750	4210	15	30.55	27.1	2.2	50	80	40	40
RCF1010-3-L	3200	3200	4320	1190	1315	5280	8700	4910	11	26.38	27.1	2.2	50	80	40	40
RCF1010-3-M	3200	3200	4320	1190	1315	5280	8700	4910	15	29.25	27.1	2.2	50	80	40	40
RCF1010-3-N	3200	3200	4320	1190	1315	5280	8700	4910	18.5	31.37	27.1	2.2	50	80	40	40
RCF1111-2-M	3500	3500	4290	1355	1120	5450	9150	5040	15	34.69	32.8	3	50	80	40	40
RCF1111-2-N	3500	3500	4290	1355	1120	5450	9150	5040	18.5	37.20	32.8	3	50	80	40	40
RCF1111-3-M	3500	3500	4485	1355	1315	6300	10300	5880	15	33.21	32.8	3	50	80	40	40
RCF1111-3-N	3500	3500	4485	1355	1315	6300	10300	5880	18.5	35.62	32.8	3	50	80	40	40
RCF1111-3-O	3500	3500	4485	1355	1315	6300	10300	5880	22	37.74	32.8	3	50	80	40	40



ENGINEERING DATA - 304SST COIL UNIT DIMENSIONS:

Single Fan Units - Rectangular Box Sizes

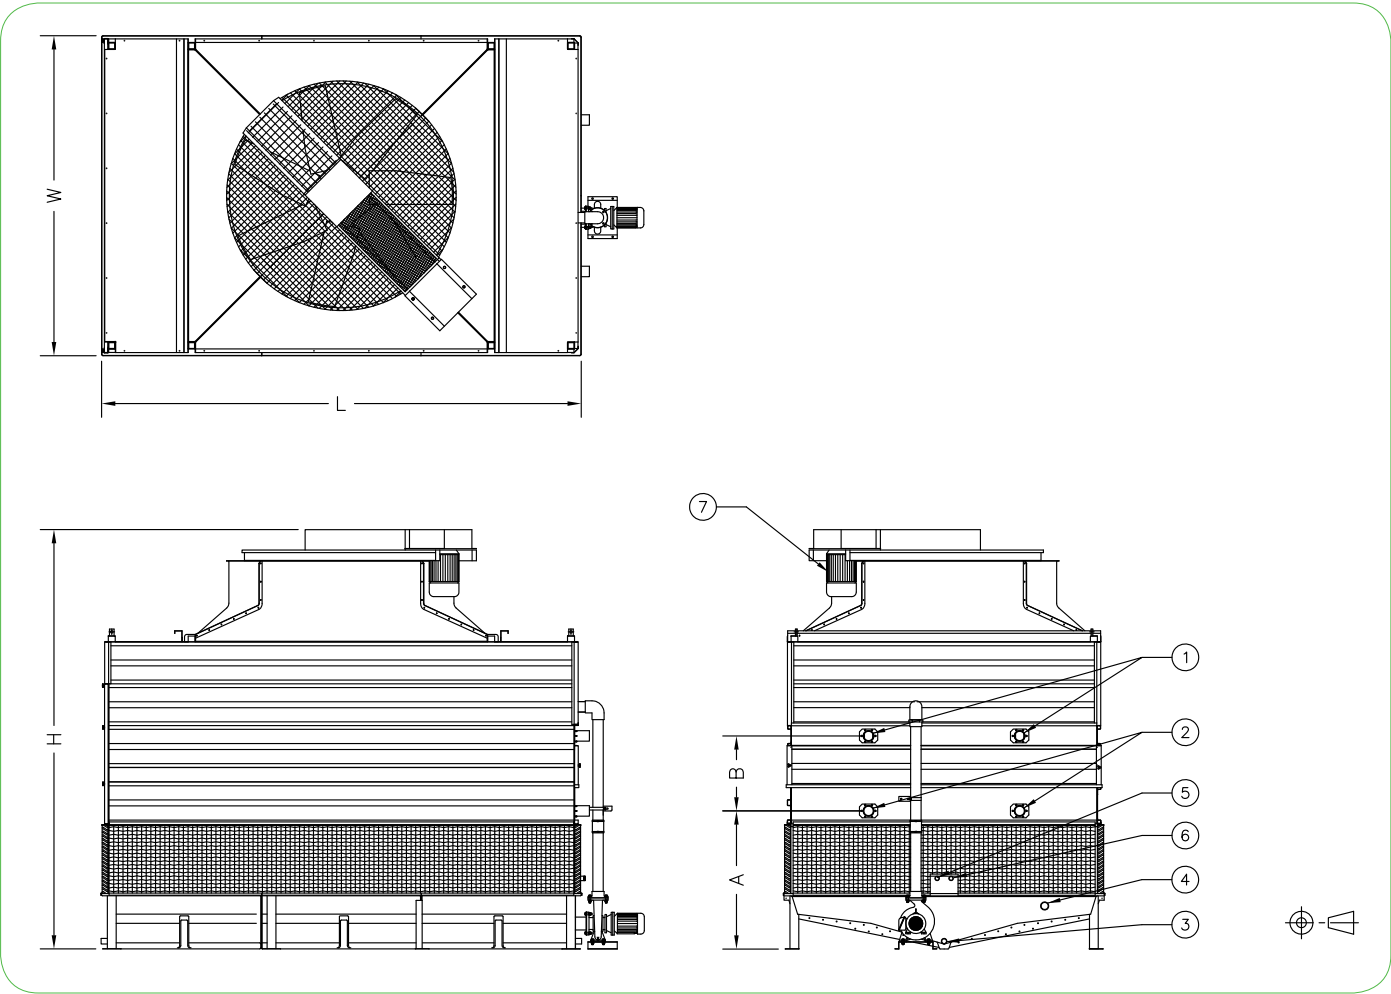

1. Fluid Inlet 100NB (Box Size 5x5, 6x6, 7x7 and 7x10.5 Have Single Coil Connection); 2. Fluid Outlet 100NB (Box Size 5x5, 6x6, 7x7 and 7x10.5 Have Single Coil Connection); 3. Drain; 4. Overflow; 5. Make-Up; 6. Quick Fill; 7. Fan Motor.




ENGINEERING DATA - 304SST COIL UNIT DIMENSIONS:

Model No. RCF (SST Coil)	W (mm)	L (mm)	H (mm)	A	B	Shipping Weight (kg)	Operating Weight (kg)	Heaviest Section (kg)	Fan Motor (kW)	Air Flow (m³/s)	Water Flow (l/s)	Pump Motor (kW)	Drain NB (mm)	Overflow NB (mm)	Make -Up NB (mm)	Quick -fill NB (mm)
RCF0710-2-J	2285	3270	4535	1310	1120	3580	6150	3070	5.5	15.92	20.4	1.5	50	80	40	40
RCF0710-2-K	2285	3270	4535	1310	1120	3580	6150	3070	7.5	17.65	20.4	1.5	50	80	40	40
RCF0710-2-L	2285	3270	4535	1310	1120	3580	6150	3070	11	20.06	20.4	1.5	50	80	40	40
RCF0710-3-L	2285	3270	4710	1310	1315	4090	6850	3580	11	19.21	20.4	1.5	50	80	40	40
RCF0710-3-M	2285	3270	4710	1310	1315	4090	6850	3580	15	21.30	20.4	1.5	50	80	40	40
RCF0812-2-L	2590	3880	4465	1310	1120	4560	7850	4180	11	23.99	26.5	2.2	50	80	40	40
RCF0812-2-M	2590	3880	4465	1310	1120	4560	7850	4180	15	26.60	26.5	2.2	50	80	40	40
RCF0812-3-L	2590	3880	4640	1310	1315	5230	8750	4850	11	22.97	26.5	2.2	50	80	40	40
RCF0812-3-M	2590	3880	4640	1310	1315	5230	8750	4850	15	25.47	26.5	2.2	50	80	40	40
RCF0812-3-N	2590	3880	4640	1310	1315	5230	8750	4850	18.5	27.31	26.5	2.2	50	80	40	40
RCF0913-2-M	2895	4335	4525	1300	1120	5710	9650	5250	15	31.14	33.5	3	50	80	40	40
RCF0913-2-N	2895	4335	4525	1300	1120	5710	9650	5250	18.5	33.40	33.5	3	50	80	40	40
RCF0913-3-M	2895	4335	4700	1300	1315	6560	10800	6090	15	29.82	33.5	3	50	80	40	40
RCF0913-3-N	2895	4335	4700	1300	1315	6560	10800	6090	18.5	31.98	33.5	3	50	80	40	40
RCF0913-3-O	2895	4335	4700	1300	1315	6560	10800	6090	22	33.88	33.5	3	50	80	40	40
RCF1015-2-N	3200	4790	4720	1310	1120	6870	11600	6310	18.5	38.46	41.3	4	50	80	40	40
RCF1015-2-O	3200	4790	4720	1310	1120	6870	11600	6310	22	40.74	41.3	4	50	80	40	40
RCF1015-3-N	3200	4790	4895	1310	1315	7920	13000	7360	18.5	36.82	41.3	4	50	80	40	40
RCF1015-3-O	3200	4790	4895	1310	1315	7920	13000	7360	22	39.01	41.3	4	50	80	40	40
RCF1015-3-P	3200	4790	4895	1310	1315	7920	13000	7360	30	43.26	41.3	4	50	80	40	40
RCF1116-2-O	3500	5247	4905	1510	1120	8180	13700	7560	22	46.28	49.9	5.5	50	80	40	40
RCF1116-2-P	3500	5247	4905	1510	1120	8180	13700	7560	30	51.32	49.9	5.5	50	80	40	40
RCF1116-3-O	3500	5247	5080	1510	1315	9450	15400	8820	22	44.32	49.9	5.5	50	80	40	40
RCF1116-3-P	3500	5247	5080	1510	1315	9450	15400	8820	30	49.14	49.9	5.5	50	80	40	40



## ENGINEERING DATA - HDG COIL UNIT DIMENSIONS:

### Single Fan Units - Square Box Sizes

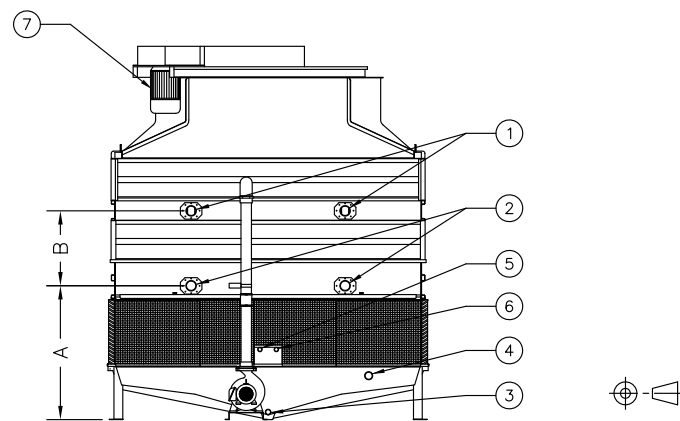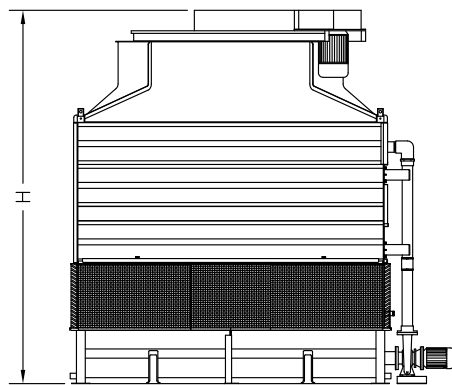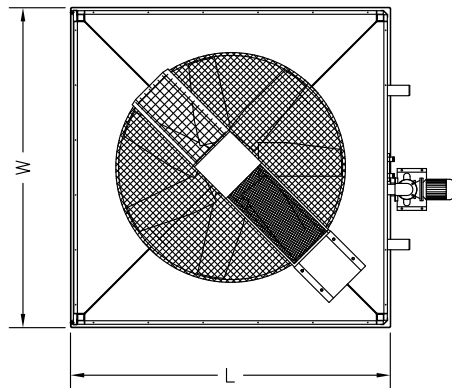

1. Fluid Inlet 100NB (Box Size 5x5, 6x6, 7x7 and 7x10.5 Have Single Coil Connection); 2. Fluid Outlet 100NB (Box Size 5x5, 6x6, 7x7 and 7x10.5 Have Single Coil Connection); 3. Drain; 4. Overflow; 5. Make-Up; 6. Quick Fill; 7. Fan Motor.


## ENGINEERING DATA - HDG COIL UNIT DIMENSIONS:

Model No. RCF (SST Coil)	W (mm)	L (mm)	H (mm)	A	B	Shipping Weight (kg)	Operating Weight (kg)	Heaviest Section (kg)	Fan Motor (kW)	Air Flow (m³/s)	Water Flow (l/s)	Pump Motor (kW)	Drain NB (mm)	Overflow NB (mm)	Make -Up NB (mm)	Quick -fill NB (mm)
RCF0505-2-I	1675	1675	3010	910	820	1380	2300	1050	4	7.61	6.8	0.55	50	50	15	15
RCF0505-3-I	1675	1675	3315	910	1120	1560	2550	1230	4	7.28	6.8	0.55	50	50	15	15
RCF0505-3-J	1675	1675	3315	910	1120	1560	2550	1230	5.5	8.31	6.8	0.55	50	50	15	15
RCF0606-2-G	1980	1980	3280	970	820	1830	3150	1549	2.2	8.15	9.8	1.1	50	50	15	15
RCF0606-2-I	1980	1980	3280	970	820	1830	3150	1549	4	9.69	9.8	1.1	50	50	15	15
RCF0606-2-J	1980	1980	3280	970	820	1830	3150	1549	5.5	11.06	9.8	1.1	50	50	15	15
RCF0606-3-I	1980	1980	3585	970	1120	2080	3500	1800	4	9.28	9.8	1.1	50	50	15	15
RCF0606-3-J	1980	1980	3585	970	1120	2080	3500	1800	5.5	10.59	9.8	1.1	50	50	15	15
RCF0606-3-K	1980	1980	3585	970	1120	2080	3500	1800	7.5	11.75	9.8	1.1	50	50	15	15
RCF0707-2-I	2285	2285	3470	1025	820	2390	4100	2050	4	11.91	13.3	1.1	50	50	20	20
RCF0707-2-J	2285	2285	3470	1025	820	2390	4100	2050	5.5	13.59	13.3	1.1	50	50	20	20
RCF0707-2-K	2285	2285	3470	1025	820	2390	4100	2050	7.5	15.07	13.3	1.1	50	50	20	20
RCF0707-3-J	2285	2285	3775	1025	1120	2730	4600	2390	5.5	13.01	13.3	1.1	50	50	20	20
RCF0707-3-K	2285	2285	3775	1025	1120	2730	4600	2390	7.5	14.43	13.3	1.1	50	50	20	20
RCF0707-3-L	2285	2285	3775	1025	1120	2730	4600	2390	11	16.40	13.3	1.1	50	50	20	20
RCF0808-2-K	2590	2590	3450	1075	820	3050	5250	2790	7.5	18.01	17.4	1.5	50	80	20	20
RCF0808-2-L	2590	2590	3450	1075	820	3050	5250	2790	11	20.46	17.4	1.5	50	80	20	20
RCF0808-3-K	2590	2590	3755	1075	1120	3500	5850	3230	7.5	17.24	17.4	1.5	50	80	20	20
RCF0808-3-L	2590	2590	3755	1075	1120	3500	5850	3230	11	19.59	17.4	1.5	50	80	20	20
RCF0909-2-K	2895	2895	3580	1135	820	3810	6450	3500	7.5	21.07	22.0	1.5	50	80	20	20
RCF0909-2-L	2895	2895	3580	1135	820	3810	6450	3500	11	23.94	22.0	1.5	50	80	20	20
RCF0909-3-L	2895	2895	3885	1135	1120	4380	7200	4060	11	22.92	22.0	1.5	50	80	20	20
RCF0909-3-M	2895	2895	3885	1135	1120	4380	7200	4060	15	25.41	22.0	1.5	50	80	20	20
RCF1010-2-L	3200	3200	3820	1190	820	4580	7750	4210	11	27.55	27.1	2.2	50	80	40	40
RCF1010-2-M	3200	3200	3820	1190	820	4580	7750	4210	15	30.55	27.1	2.2	50	80	40	40
RCF1010-3-L	3200	3200	4125	1190	1120	5280	8700	4910	11	26.38	27.1	2.2	50	80	40	40
RCF1010-3-M	3200	3200	4125	1190	1120	5280	8700	4910	15	29.25	27.1	2.2	50	80	40	40
RCF1010-3-N	3200	3200	4125	1190	1120	5280	8700	4910	18.5	31.37	27.1	2.2	50	80	40	40
RCF1111-2-M	3500	3500	3985	1355	820	5450	9150	5040	15	34.69	32.8	3	50	80	40	40
RCF1111-2-N	3500	3500	3985	1355	820	5450	9150	5040	18.5	37.20	32.8	3	50	80	40	40
RCF1111-3-M	3500	3500	4290	1355	1120	6300	10300	5880	15	33.21	32.8	3	50	80	40	40
RCF1111-3-N	3500	3500	4290	1355	1120	6300	10300	5880	18.5	35.62	32.8	3	50	80	40	40
RCF1111-3-O	3500	3500	4290	1355	1120	6300	10300	5880	22	37.74	32.8	3	50	80	40	40



ENGINEERING DATA - HDG COIL UNIT DIMENSIONS:

Single Fan Units - Rectangular Box Sizes

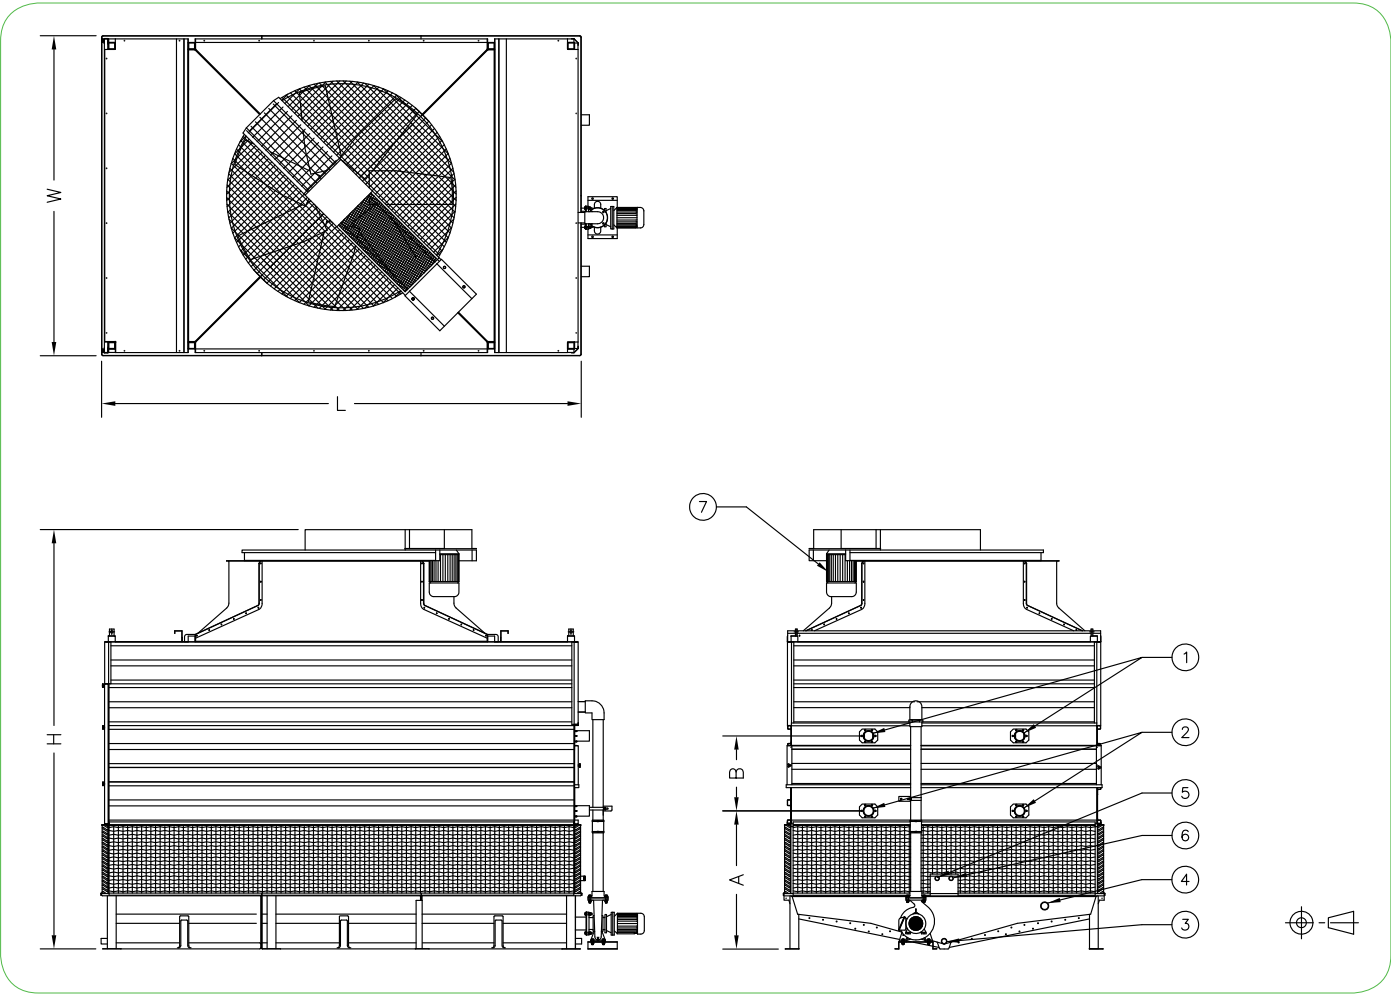

1. Fluid Inlet 100NB (Box Size 5x5, 6x6, 7x7 and 7x10.5 Have Single Coil Connection); 2. Fluid Outlet 100NB (Box Size 5x5, 6x6, 7x7 and 7x10.5 Have Single Coil Connection); 3. Drain; 4. Overflow; 5. Make-Up; 6. Quick Fill; 7. Fan Motor.

ENGINEERING DATA - HDG COIL UNIT DIMENSIONS:

Model No. RCF (SST Coil)	W (mm)	L (mm)	H (mm)	A	B	Shipping Weight (kg)	Operating Weight (kg)	Heaviest Section (kg)	Fan Motor (kW)	Air Flow (m³/s)	Water Flow (l/s)	Pump Motor (kW)	Drain NB (mm)	Overflow NB (mm)	Make -Up NB (mm)	Quick -fill NB (mm)
RCF0710-2-J	2285	3270	4215	1310	820	3580	6150	3070	5.5	15.92	20.4	1.5	50	80	40	40
RCF0710-2-K	2285	3270	4215	1310	820	3580	6150	3070	7.5	17.65	20.4	1.5	50	80	40	40
RCF0710-2-L	2285	3270	4215	1310	820	3580	6150	3070	11	20.06	20.4	1.5	50	80	40	40
RCF0710-3-L	2285	3270	4535	1310	1120	4090	6850	3580	11	19.21	20.4	1.5	50	80	40	40
RCF0710-3-M	2285	3270	4535	1310	1120	4090	6850	3580	15	21.30	20.4	1.5	50	80	40	40
RCF0812-2-L	2590	3880	4145	1310	820	4560	7850	4180	11	23.99	26.5	2.2	50	80	40	40
RCF0812-2-M	2590	3880	4145	1310	820	4560	7850	4180	15	26.60	26.5	2.2	50	80	40	40
RCF0812-3-L	2590	3880	4465	1310	1120	5230	8750	4850	11	22.97	26.5	2.2	50	80	40	40
RCF0812-3-M	2590	3880	4465	1310	1120	5230	8750	4850	15	25.47	26.5	2.2	50	80	40	40
RCF0812-3-N	2590	3880	4465	1310	1120	5230	8750	4850	18.5	27.31	26.5	2.2	50	80	40	40
RCF0913-2-M	2895	4335	4205	1300	820	5710	9650	5250	15	31.14	33.5	3	50	80	40	40
RCF0913-2-N	2895	4335	4205	1300	820	5710	9650	5250	18.5	33.40	33.5	3	50	80	40	40
RCF0913-3-M	2895	4335	4525	1300	1120	6560	10800	6090	15	29.82	33.5	3	50	80	40	40
RCF0913-3-N	2895	4335	4525	1300	1120	6560	10800	6090	18.5	31.98	33.5	3	50	80	40	40
RCF0913-3-O	2895	4335	4525	1300	1120	6560	10800	6090	22	33.88	33.5	3	50	80	40	40
RCF1015-2-N	3200	4790	4400	1310	820	6870	11600	6310	18.5	38.46	41.3	4	50	80	40	40
RCF1015-2-O	3200	4790	4400	1310	820	6870	11600	6310	22	40.74	41.3	4	50	80	40	40
RCF1015-3-N	3200	4790	4720	1310	1120	7920	13000	7360	18.5	36.82	41.3	4	50	80	40	40
RCF1015-3-O	3200	4790	4720	1310	1120	7920	13000	7360	22	39.01	41.3	4	50	80	40	40
RCF1015-3-P	3200	4790	4720	1310	1120	7920	13000	7360	30	43.26	41.3	4	50	80	40	40
RCF1116-2-O	3500	5247	4585	1510	820	8180	13700	7560	22	46.28	49.9	5.5	50	80	40	40
RCF1116-2-P	3500	5247	4585	1510	820	8180	13700	7560	30	51.32	49.9	5.5	50	80	40	40
RCF1116-3-O	3500	5247	4905	1510	1120	9450	15400	8820	22	44.32	49.9	5.5	50	80	40	40
RCF1116-3-P	3500	5247	4905	1510	1120	9450	15400	8820	30	49.14	49.9	5.5	50	80	40	40





## COUNTER FLOW PRODUCT LAYOUT:

Evaporative fluid coolers depend upon an adequate supply of fresh, ambient air to provide design capacity. Other important considerations such as the proximity to building air intakes or discharges also must be taken into account when selecting and designing the equipment site. This bulletin presents the design guidelines for siting counter flow products in several situations typically encountered by designers. All of the guidelines present recommended spacing requirements for good performance, but more liberal spacing should be provided where possible.


Also, note that as the size of an installation grows larger and larger, the total amount of heat being rejected to the atmosphere and the volume of discharge air increases accordingly -- to the point where the fluid coolers virtually create their own environment. As a result, it becomes increasingly difficult to apply a set of correct general guidelines for every case. Consequently, it is recommended the layout of large counter flow product installations be referred to your local BAC representative or Balticare sales office for review.

As is typical of axial fan equipment, counter flow products are not generally suited for indoor or ducted applications. In such situations, centrifugal fan units are preferred.

### General Considerations:

When selecting the site for a counter flow product installation, consider the following factors;

1. Locate the unit to prevent the warm discharge air and any associated drift from being introduced into the fresh air intakes of the building(s) served by the unit or the intakes of neighbouring buildings.
2. Consider the potential for plume formation and its effect on the surroundings, such as large windowed areas, and pedestrian or vehicular traffic arteries.
3. Provide sufficient unobstructed space around the unit(s) to ensure an adequate supply of fresh, ambient air to the intake. Avoid situations where adjacent walls or structures might deflect some of the discharge airstream back into the air inlet (recirculation) or promote recirculation by generating high, downward air velocities in the vicinity of the intake. Also, avoid locations where building air intakes or exhausts, such as boiler stacks in the vicinity of the unit, might raise the inlet wet bulb temperature or starve the unit of air.
4. Provide adequate space around the unit for piping and proper servicing and maintenance as shown in Figure 1 and Table 1.
5. The top of the fan discharge cylinders must be at least level with and preferably higher than any adjacent walls or buildings.
6. For installations involving multiple units if cells are arranged with the air inlets facing, the dimensions given should be doubled for adequate air to each unit. Alternatively unit may need to be de-rated or air inlet height increased.

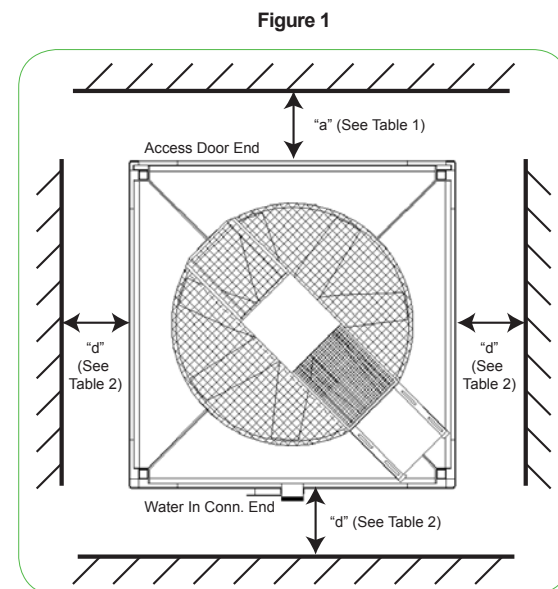

## COUNTER FLOW PRODUCT LAYOUT:

Table 1: Access Clearance

Model Number	Box Size (ft)	Access Clearance "a" (m)
RCF-0505	5' x 5'	1.5
RCF-0606	6' x 6'	1.5
RCF-0707	7' x 7'	1.5
RCF-0808	8' x 8'	1.5
RCF-0909	9' x 9'	1.5
RCF-1010	10' x 10'	1.8
RCF-1111	11' x 11'	1.8
RCF-0710	7' x 10.5'	1.5
RCF-0812	8' x 12'	1.5
RCF-0913	9' x 13.5'	1.5
RCF-1015	10' x 15'	1.8
RCF-1116	11' x 16.5'	1.8

### Layout Guidelines

The "Layout Guidelines" section of this bulletin describe several typical siting situations for counter flow products. If these guidelines do not cover a particular situation or if the layout criteria cannot be met, please refer the application to your local BAC representative or Balticare sales office for review. Please indicate prevailing wind direction, geographic orientation of the unit(s), and other factors such as large buildings and other obstructions that may influence layout decisions.

The most common counter flow product installations can be divided into three basic categories, adjacent to a wall/ building, in a well, and behind louvres. The three situations are described below.

#### A. Adjacent to a Building or Wall

1. Unit Orientation:  
When a counter flow product is located near a building wall, the preferred arrangement is to have the "short" side (if applicable) facing the adjacent wall or building.
2. Clearance:  
Maintain clearance for access as outlined in Figure 1 and Table 1.
3. Air Inlet Requirements:  
Should it ever be necessary to install a unit with the air inlet facing a wall, allow a minimum "d" dimension between the fluid cooler air inlets and the wall as outlined in Figure 1 and Table 2.

Table 2: Minimum Air Inlet Distance "d" to Solid Wall or in Well

Model Number	Box Size (ft)	"d" (m)
RCF-0505	5' x 5'	0.9
RCF-0606	6' x 6'	0.9
RCF-0707	7' x 7'	0.9
RCF-0808	8' x 8'	1.1
RCF-0909	9' x 9'	1.4
RCF-1010	10' x 10'	1.4
RCF-1111	11' x 11'	1.5
RCF-0710	7' x 10.5'	1.2
RCF-0812	8' x 12'	1.4
RCF-0913	9' x 13.5'	1.6
RCF-1015	10' x 15'	1.8
RCF-1116	11' x 16.5'	1.8

Note: Elevating the fluid cooler has no effect on these "d" dimensions.



## COUNTER FLOW PRODUCT LAYOUT:

### B. The Well Installation

#### 1. Unit Orientation:

When a counter flow product is located in a well

- Centre the fluid cooler within the enclosure so the supply air flows uniformly to all fluid cooler air inlets.
- The top of the fan discharge cylinder must be level with or higher than the adjacent walls.

#### 2. Clearance:

Maintain clearance for access as outlined in Figure 1 and Table 1.

#### 3. Air Inlet Requirements:

To satisfy air inlet requirements in a well enclosure, allow a minimum "d" dimension between the fluid cooler air inlets and the wall as outlined in Figure 2 and Table 2.

### C. The Louvred or Slotted Wall Installations:

Check to see if the layout meets the requirements for a well installation. If the criteria for the well location are met, the layout is satisfactory. If the layout does not satisfy the criteria for the well installation, analyse the layout as follows:

#### 1. Unit Orientation:

When a counter flow product is located in a louvred enclosure

- Arrange the fluid cooler air intakes to directly face louvres.
- The top of the fan discharge cylinder must be level with or higher than the adjacent walls.

#### 2. Clearance:

Maintain clearance for access as outlined in Figure 1 and Table 1.

Figure 2 - Well Installation


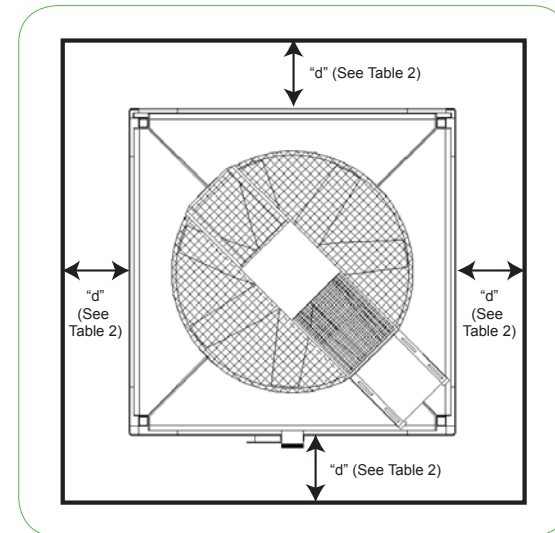


Figure 3 - Louvred enclosure installation

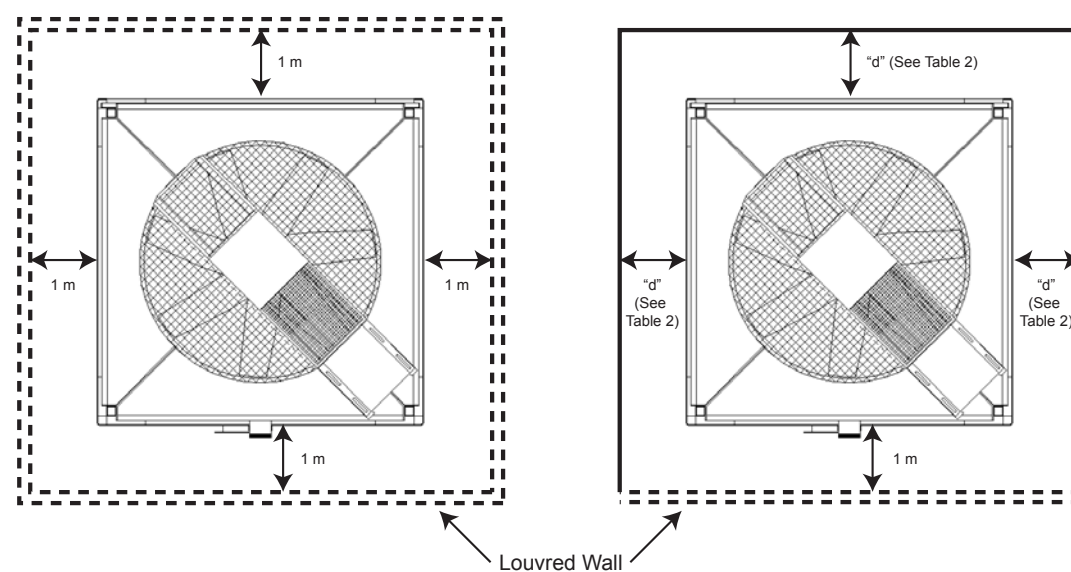

## COUNTER FLOW PRODUCT LAYOUT:

### 3. Air Inlet Requirements:


To satisfy air inlet requirements when a counter flow product is located in a louvred enclosure

- Maintain distances as shown in Figure 3.
- Louvres *must* provide at least 50% net free area.
- Determine the louvre or slot area required based on drawing the airflow through the net free area of the louvres at a velocity of 600 fpm or less. Calculate the louvre velocity as follows:

$$\text{Louvre Velocity} = \frac{\text{Total Unit Airflow (CFM)}}{\% \text{ louvre free area} \times \text{gross louvre area (ft}^2\text{)}} \leq 600 \text{ fpm (3m/s)}$$

Extending the louvred or slot area below the base of the fluid cooler if needed is acceptable to achieve the minimum gross louvre area required. The fluid cooler, however, must be elevated above the base of the enclosure to satisfy requirements 1b above. The usable louvred or slot area may also be extended beyond the ends of the fluid coolers as shown in Figure 4.

Figure 4 - Usable louvred area

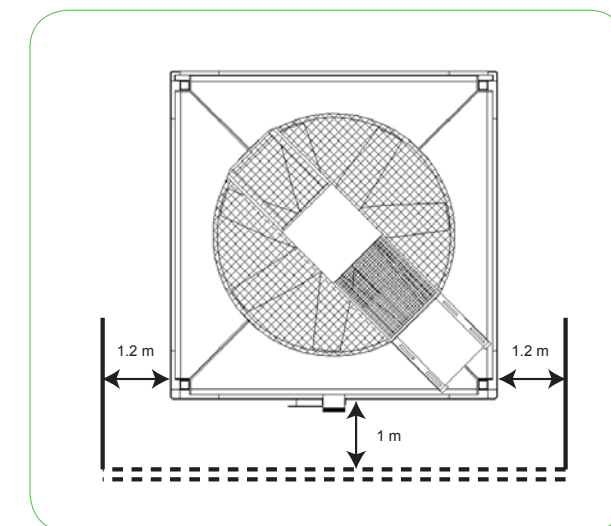





## ENGINEERING SPECIFICATIONS:

### 1.0 Closed Circuit Cooling Tower

**1.1 General:** Furnish and install \_\_\_\_factory assembled, induced draft, counter-flow, axial fan, evaporative fluid cooler(s) with vertical air discharge, conforming in all aspects to the specifications and schedules as shown on the plans. Overall dimensions shall not exceed approximately \_\_\_\_m long x \_\_\_\_m wide x \_\_\_\_m high. The total connected fan horsepower shall not exceed \_\_\_\_kW. The fluid cooler(s) shall be Baltimore Aircoil Company Model(s) \_\_\_\_\_.

**1.2 Thermal Capacity:** The closed-circuit cooling tower(s) shall be warranted by the manufacturer to cool \_\_\_\_USGPM (l/s) of \_\_\_\_ water from \_\_\_\_°C to \_\_\_\_°C at \_\_\_\_°C entering wet-bulb temperature. The thermal performance shall be certified by the Cooling Technology Institute in accordance with CTI Certification Standard STD-201. A manufacturer's performance guarantee or performance bond without CTI Certification will not be accepted.

**1.3 Quality Assurance:** The manufacturer shall have a Management System certified by an accredited registrar as complying with the requirements of ISO-9001 to ensure consistent quality of products and services. Manufacturers that are not ISO-9001 certified shall not be acceptable.

### 2.0 Construction Details

#### Casing

**2.1 Corrosion Resistant Standard Construction:** Casing panels and supporting structure shall be constructed of superior strength pultruded composite. All pultruded composite components shall be moulded to exacting standards with UV resistant polyester resins such that the UV protection is afforded throughout the entire embodiment of the components as well as being an externally applied coating. All internal component supports shall be constructed of Type 304 Stainless Steel. All hardware joining steel parts shall be of Type 304 Stainless Steel.

**(Alternate 2.1) Corrosion Resistant Type 316 Stainless Steel Construction:** Casing panels and supporting structure shall be constructed of superior strength pultruded composite. All pultruded composite components shall be moulded to exacting standards with UV resistant polyester resins such that the UV protection is afforded throughout the entire embodiment of the components as well as being an externally applied coating. All internal component supports shall be constructed of Type 316 Stainless Steel. All hardware joining steel parts shall be of Type 316 Stainless Steel.

#### Fan Cowl and Mechanical Equipment

**2.2 Corrosion Resistant Standard Construction:** Fan cowl sections shall be constructed of high performance Fibreglass Reinforced Polyester (FRP) and reinforced in critical areas. Sections shall be fastened together with Type 304 Stainless Steel hardware. All mechanical equipment supporting structure parts shall be constructed of ZAM coated steel. The fan shaft shall be of Type 316 Stainless Steel.

**(Alternate 2.2) Corrosion Resistant Type 304 Stainless Steel Construction:** Fan cowl sections shall be constructed of high performance Fibreglass Reinforced Polyester (FRP) and reinforced in critical areas. Sections shall be fastened together with Type 304 Stainless Steel hardware. All mechanical equipment supporting structure parts shall be constructed of Type 304 Stainless Steel. The fan shaft shall be of Type 316 Stainless Steel.

**(Alternate 2.2) Corrosion Resistant Type 316 Stainless Steel Construction:** Fan cowl sections shall be constructed of high performance Fibreglass Reinforced Polyester (FRP) and reinforced in critical areas. Sections shall be fastened together with Type 316 Stainless Steel hardware. All mechanical equipment supporting structure parts shall be constructed of Type 316 Stainless Steel. The fan shaft shall be of Type 316 Stainless Steel.

## ENGINEERING SPECIFICATIONS:

### 2.0 Construction Details cont.

#### Cold Water Basin

**2.3 Cold Water Basin:** The cold water basin shall be constructed of high performance Fibreglass Reinforced Polyester (FRP) and reinforced in critical areas. All connections and other steel parts in the wetted area shall be constructed of Type 304 Stainless Steel. Standard basin accessories shall include: a corrosion resistant make-up valve with large diameter plastic float for easy adjustment of the operating water level, removable anti-vortexing strainer with perforated openings sized smaller than the water distribution system nozzles.

**(Alternate 2.3)** The cold water basin shall be constructed of high performance Fibreglass Reinforced Polyester (FRP) and reinforced in critical areas. All connections and other steel parts in the wetted area shall be constructed of Type 316 Stainless Steel. Standard basin accessories shall include: a corrosion resistant make-up valve with large diameter plastic float for easy adjustment of the operating water level, removable anti-vortexing strainer with perforated openings sized smaller than the water distribution system nozzles.

**2.4 Air Inlet Louvre Screens:** All louvres shall be constructed from PVC. Louvre sections shall be individually removable in sections of no greater than 48" wide, allowing for quick and easy access to any part of the cold water basin without the need for tools. Louvres shall prevent debris and sunlight from entering the cold water basin as well as preventing splash out. Louvres which require tools for removal shall not be an acceptable alternative.

**2.5 Casing Field Joint:** The field joint shall be self aligning and require a minimum number of fasteners.

**2.6 Coil Casing Assembly:** The evaporative fluid cooler(s) shall include a coil casing section consisting of a refrigerant condensing coil, a spray water distribution system, and drift eliminators as indicated by the manufacturer.

**2.6.1 Prime Surface Coil HDG Construction:** The coil shall be fabricated of all prime surface steel at the manufacturers own facility, and hot-dip galvanised after fabrication. The coil shall be tested at 2750 kPa air pressure under water and be designed for low pressure drop.

**(Alternate 2.6.1) Prime Surface Coil SST 304 Construction:** The coil shall be fabricated of all prime surface Type 304 Stainless Steel at the manufacturers own facility. The coil shall be tested at 2750 kPa air pressure under water and be designed for low pressure drop.

**(Alternate 2.6.1) Prime Surface Coil SST 316 Construction:** The coil shall be fabricated of all prime surface Type 316 Stainless Steel at the manufacturers own facility. The coil shall be tested at 2750 kPa air pressure under water and be designed for low pressure drop.

**2.6.2 Water Distribution System:** Water shall be distributed evenly over the coil to ensure complete wetting of the coil at all times by a water distribution system consisting of a header and spray branches of Schedule 40 PVC pipe with large orifice, non-clog plastic distribution nozzles. The spray nozzles shall be held in place by snap-in rubber grommets and the branches should be removable without tools or removal of branch supports, allowing quick removal of individual nozzles or complete branches for cleaning or flushing. Branches that require tools for removal or removal of branch supports shall not be an acceptable alternative.

**2.6.3 Drift Eliminators:** Eliminators shall be constructed of PVC and shall be UV resistant and impervious to rot, decay and fungus or biological attacks. They shall consist of high efficiency three pass wave formed blades solvent welded into lightweight, easily removable sections. Drift loss shall be less than 0.002% of the circulated water flow as required by AS3666.





## ENGINEERING SPECIFICATIONS:

### 3.0 Mechanical Equipment

**3.1 Fan(s):** Fan(s) shall be axial flow with glass reinforced polypropylene or glass reinforced polyamide blades selected to provide optimum fluid cooler thermal performance with minimal sound levels. Air shall discharge through a fan cylinder designed for streamlined air entry and minimum tip clearance for maximum fan efficiency. The top of the fan cylinder shall be equipped with a non-sagging removable fan guard. The fan(s) and fan drive system, including the fan motor, shall be factory test-mounted and aligned to ensure reliable operation and ease of maintenance.

**3.2 Bearings (belt driven units):** Fan(s) and shaft(s) shall be supported by heavy-duty, self-aligning, grease packed ball bearings with moisture proof seals and integral slinger collars, designed for L- 10 Life. Extended bearing lube lines shall be fitted for ease of maintenance.

**3.3 Fan Drive:** The fan shall be either direct driven or belt driven. Where belts are used they shall be standard “A” or “B” section belts for ease of availability and be designed for 150% of the motor nameplate horsepower.

**3.4 Fan Motor (direct drive units):** Fan motor(s) shall be MEPS2 2006 compliant and be totally enclosed air over (TEAO), reversible, squirrel cage, ball bearing type, epoxy coated and be to IP66 protection rating. The motor(s) shall be mounted above the fan, protruding the top of the fan cowl for ease of access for lubrication and maintenance.

**(Alternate 3.4) Fan Motor (belt drive units):** Fan motor(s) shall be MEPS2 2006 compliant and be Totally Enclosed Fan Cooled (TEFC), reversible, squirrel cage, ball bearing type and be to IP55 protection rating. A removable protective cover shall protect the motor from the elements. Motor adjustments shall be made from the exterior of the unit. Internally mounted motors shall not be an acceptable alternative.

### 4.0 Access

**4.1 Fluid Cooler Access:** One full side of the casing shall be removable to provide full and open access to all internal fluid cooler components for inspection, maintenance and cleaning. The access panel shall be retained by easily removable knobs and when removed shall not compromise structural integrity of the fluid cooler. Additionally a second access panel of similar design shall be provided on the coil connection end of the fluid cooler to provide access to the coil return bends for inspection and cleaning.

### 5.0 Sound

**5.1 Sound Level:** Sound rating data are available for all RCF evaporative fluid coolers which can be used to calculate sound levels generated by the fluid cooler. When making such calculations, the designer must take into account the effects of geometry of the fluid cooler installations as well as the distance and direction from the fluid cooler to noise sensitive areas.

### 6.0 Accessories

**6.1 Basin Heater(s):** The fluid cooler cold water basin shall be provided with electric heater(s) to prevent freezing in low ambient conditions. The heater(s) shall be \_\_\_\_\_kW \_\_\_\_\_V/\_\_\_\_phase/\_\_\_\_Hz electric and shall be provided with a thermostat.

## ENGINEERING SPECIFICATIONS:

### 6.0 Accessories cont.

**6.2 Basin Water Level Control:** The fluid cooler manufacturer shall provide an Electric Water Level Control (EWLC) system. The system shall consist of an electric float switch with stainless steel stilling chamber and a brass body solenoid valve in quantities and locations as indicated on the drawings. The system shall be capable of handling water pressures ranging from 0.3 – 10 bar and accept 240V/1PH/50Hz power supply. Electrical enclosures shall be of IP65 protection and the float switch shall be of single pole single throw type. The valve shall have female BSP threaded connections and shall be slow closing and of a water hammer damped type.

**(Alternative 6.2) Basin Water Level Control:** A liquid level control device shall be fitted externally to the cooling tower basin to maintain adequate water level through a pilot operated valve. The device shall consist of an externally mounted stilling chamber with float mechanism and controller valve, and a pilot operated make up valve fitted to the fluid cooler make up connection.

**6.3 Vibration Cutout Switch:** A mechanical local reset vibration switch shall be fitted to the mechanical assembly of the fluid cooler. It shall be designed to trip at a point so as not to cause damage to the fluid cooler. The switch time delay and trip point shall be preset to typical values. Adjustment for these settings shall be available.

**(Alternative 6.3) Vibration Cutout Switch:** An electronic remote reset vibration switch with contact for BAS monitoring shall be fitted to the mechanical assembly of the fluid cooler. Wiring shall be by the installing contractor. The electronic vibration cut out switch shall be set to trip at a point so as not to cause damage to the fluid cooler. The switch time and trip point shall be preset to typical values. Adjustment of these settings shall be available.

**6.4 Basin Sweeper Piping:** The cold water basin of the fluid cooler shall be equipped with PVC basin sweeper piping suitable for use with a filter or separator (supplied by others).

**6.5 Extended Fan Cowl:** The unit shall be equipped with a ZAM cylinder fitted to the top of the fan cowl suitable for connecting duct work.

**6.6 External Access – Roof deck Access Pod:** Provide an external ZAM access pod at the roof deck level of the unit(s) to allow access to the drive system. A hot-dip galvanised ladder from unit footing height to the pod at 15 deg to vertical shall be included. Field installation is by others. The installation shall be designed in accordance with AS 1657-1992.

### 7.0 Equipment Controls

**7.1 Variable Speed Drive(s):** A Variable Speed Drive (VSD) shall be provided for each fan motor. It shall be factory mounted externally to the unit and be pre-wired and set to the required duty. The supplier of the VSD shall be the manufacturer of the evaporative cooling equipment. The VSD shall have 98% basic energy efficiency, sleep mode, automatic energy optimisation, flow compensation, and have a removable control panel. The drive shall be to IP66 protection rating and be capable of running at full load at temperatures up to 50°C.





## ***CLOSED CIRCUIT COOLING TOWERS***

### **Head Office & Manufacturing Facility**

Baltimore Aircoil Australia Pty. Ltd.  
120 Wisemans Ferry Road, Somersby NSW 2250

[info@baltimoreaircoil.com.au](mailto:info@baltimoreaircoil.com.au)

[www.baltimoreaircoil.com.au](http://www.baltimoreaircoil.com.au)

**For more details contact your local BAC Balticare representative on:**

Australia • New Zealand

**1300 134 622 • 0800-BALTICARE**



**Baltimore Aircoil**